User's Manual

YTA Series

YTA70
Temperature Transmitter

IM 01C50C03-01EN

vigilantplant.®

7th Edition: July 2011 (YK)
All Rights Reserved, Copyright © 1999, Yokogawa Electric Corporation

YOKOGAWA ◆
Yokogawa Electric Corporation

IM 01C50C03-01EN
7th Edition

YOKOGAWA ◆

YOKOGAWA ELECTRIC CORPORATION
Headquarters
2-9-32, Nakacho, Musashino-shi, Tokyo, 180-8750 JAPAN
Branch Sales Offices
Nagoya, Osaka, Hiroshima, Fukuoka, Sendai, Ichihara, Toyota, Kanazawa, and Kitakyusyu.

YOKOGAWA CORPORATION OF AMERICA
2 Dart Road, Newnan, Georgia 30265-1094, U.S.A.
Phone : 1-800-888-6400 Fax : 1-770-254-0928

YOKOGAWA EUROPE B. V.
Euroweg 2, 3825 HD Amersfoort, THE NETHERLANDS
Phone : 31-88-4641000 Fax : 31-88-4641111
Branch Sales Offices / Wien (Austria), Zaventem (Belgium), Ratingen (Germany), Madrid (Spain), Runcorn (United Kingdom), Milano (Italy), Velizy-Villacoublay (France), Budapest (Hungary), Stockholm (Sweden), Sola (Norway), Warszawa (Poland), Vila Nova de Gaia (Portugal), Bucharest (Romania), Dublin (Ireland)

YOKOGAWA AMERICA DO SUL LTDA.
Praca Acapulco, 31 - Santo Amaro. Sao Paulo/SP - BRAZIL
Phone : 55-11-5681-2400 Fax : 55-11-5681-4434

YOKOGAWA ELECTRIC ASIA PTE. LTD.
5 Bedok South Road, 469270 SINGAPORE
Phone : 65-6241-9933 Fax : 65-6241-2606

YOKOGAWA ELECTRIC KOREA CO., LTD.
14-1, Yangpyongdong-4Ga, Youngdeungpo-Gu, Seoul, 150-866 KOREA
Phone : 82-2-2628-6000 Fax : 82-2-2628-6400

YOKOGAWA AUSTRALIA PTY. LTD.
Tower A, 112-118 Talavera Road, Macquarie Park, N.S.W.2113, AUSTRALIA
Phone : 61-2-8870-1100 Fax : 61-2-8870-1111

YOKOGAWA INDIA LTD.
Plot No.96 Electronic City Complex, Hosur Road, Bangalore 560100, INDIA
Phone : 91-80-4158-6000 Fax : 91-80-2852-1442

YOKOGAWA CHINA CO., LTD.
3F TowerD Cartelo Crocodile Building
No.568 West Tianshan Road, Shanghai 200335, CHINA
Phone : 86-21-62396262 Fax : 86-21-62387866

June '10

SAFETY INSTRUCTIONS

Ex/I.S. installation:

- For correct use and installation the manufacturer's manual must be followed. When programming the Transmitter by PC and communication interface or a HART® terminal the intrinsically safe data shall be observed.
- The designation galvanic isolation between the transducer input and the loop supply indicates signal isolation only. It shall not be interpreted as an Intrinsically Safe galvanic isolation like an isolating barrier. Therefore ordinary care in selecting barrier and grounding shall be considered.
- The apparatus must be installed in an enclosure with an Ingress Protection of at least IP 20.
- The terminals 1 and 2 of the equipment have to be electrically connected to a linear barrier located in the non hazardous area.
- For Ex/I.S. data, see chapter 7. Approvals Options.

The YTA70 is a head mount type of temperature transmitter that accepts thermocouple or RTD input and converts it to a 4 to 20 mA DC signal for transmission. The YTA70 specifies HART communication protocol for remote configuration.
It is imperative that usres observe the instructions in this manual to ensure the protection and safety of operators.

1. Model and Suffix Codes

Model	Suffix code		Descriptions
YTA70	. . . . .		Temperature Transmitter
Output Signal	**-E**		4 to 20mA DC with digital communication (HART protocol)
Optional Specifications		**/KS2**	CENELEC ATEX (KEMA) intrinsically safe approval
		/DS2	FM intrinsically safe/Nonincendive and CENELEC ATEX (KEMA) intrinsically safe approval combination
		/SS2	IECEx intrinsically safe, FM intrinsically safe/ Nonincendive, and CENELEC ATEX (KEMA) intrinsically safe approval combination

2. Warranty

The warranty period of the instrument is as of condition shown when purchasing. Any trouble arising during the warranty period shall be replaced at free of charge.
The following problems or troubles shall not be eligible of charge-exempt repair.

- Caused by improper usage or storage of the customer which exceeds the specification requirements.
- Caused by mishandling or modification.
- Caused by fire, earthquake or other acts of God that are not directly a result of problems of the instrument.

3. Handling Precautions

(1) Read this manual throughly and carefully before handling the instruments. Observe the instructions.
(2) Store the product in location that meets the following requirements.
  - No exposure to rain or water
  - No major mechanical vibration or shock
  - Humidity and Temperature limitations
  - Ordinary conditions(25°C, 65%) is preferable.

  Otherwise, as of specified in "Standard Specifications."
(3) Avoid corrosive atmosphere for storage and installation.
(4) For safe installation of the transmitter in hazardous area, the following must be observed. The module must only be installed by qualified personnels who are familiar with the national and international laws, directives, and standards that apply to this area.
(5) Yokogawa will not be liable for malfunctions or damage resulting from any modification made to this instrument by the customer.

4. Standard Specifications

Accuracy (see table below)

Sensor type	Standard	Input ranges °C	Input ranges °F	Minimum span °C	Minimum span °F	Accuracy (value whichever is greater)
<T/C>						
B	IEC584	400 to 1820	752 to 3308	200	360	±0.1% of span or ±1.0°C
E		-100 to 1000	-148 to 1832	50	90	±0.1% of span or ±0.5°C
J		-100 to 1200	-148 to 2192	50	90	
K		-180 to 1372	-292 to 2502	50	90	
N		-180 to 1300	-292 to 2372	100	180	
R		-50 to 1760	-58 to 3200	200	360	±0.1% of span or ±1.0°C
S		-50 to 1760	-58 to 3200	200	360	
T		-200 to 400	-328 to 752	50	90	±0.1% of span or ±0.5°C
L	DIN43710	-100 to 900	-148 to 1652	50	90	
U		-200 to 600	-328 to 1112	75	135	
W3	ASTM	0 to 2300	32 to 4172	200	360	±0.1% of span or ±1.0°C
W5		0 to 2300	32 to 4172	200	360	
<RTD>						
Pt100	IEC751	-200 to 850	-328 to 1562	10	18	±0.1% of span or ±0.1°C
Ni100	DIN43760	-60 to 250	-76 to 482	10	18	±0.1% of span or ±0.2°C
DC Voltage		-800 to 800 [mV]		2.5 [mV]		±0.1% of span or ±0.01mV
Resistance		0 to 7000 [Ω]		25 [Ω]		±0.1% of span or ±0.1Ω

Cold Junction Compensation Accuracy(For T/C only)
±1°C (±1.8°F)
Ambient Temperature Effects (per 10°C Change)
For E, J, K, L, N, T and U thermocouple inputs:
±0.05% of span or ±0.25°C, whichever is greater
For R, S, B, W3 and W5 thermocouple inputs:
±0.05% of span or ±1°C, whichever is greater
For Pt100 and Ni100 RTD inputs:
±0.05% of span or ±0.05°C, whichever is greater
For DC voltage input:
±0.05% of span or ±5μV, whichever is greater
For Resistance(ohm) input:
±0.05% of span or ±0.05Ω, whichever is greater
Power Supply Effects
±0.005% of FS per Volt
RFI Effects
Tested per EN 61326, field intensity up to 10 V/m.
EMC Conformity CE
EN 61326
Maximum Zero Offset
±50% of the maximum temperature
Input Signal Source Resistance (for T/C input)
10 MΩ, or 3 kΩ at power-off
Input Lead Wire Resistance (for RTD input)
5 Ω per wire or lower
Burnout
High(NAMUR NE43 upscale) , Low(NAMUR NE43 downscale) or value within 3.5 to 20 mA
Output
Two wire 4 to 20 mA DC
Response Time
1 to 60 sec programmable
Ambient Temperature Limits (Option code may affect limit)
–40 to 85°C (–40 to 185°F)
Ambient Humidity Limits
5 to 90% RH at 40°C (104°F)
Supply Voltage
8 to 35 V DC
8 to 30 V DC for Intrinsically safe type
13.8 to 35 V DC for digital communication
Load Resistance
Limitation: 0 to (E–8)/0.0236 [Ω], where E is power supply voltage.
Isolation
Input/output isolated to 1500 V AC.
Mounting
DIN form B head mounting
Terminals
M3 screws
Weight
50 g (0.11 lb)

5. Block Diagram

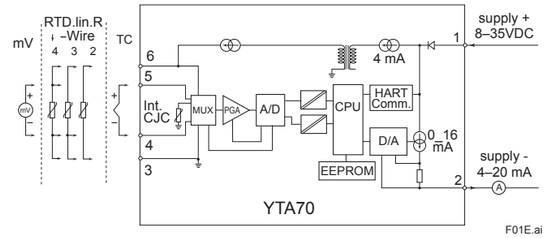

F01E.ai

6. Wiring

See wiring diagram. For output signal, use twisted pair or cables with performance equivalent to 600V vinyl insulate cable. For wiring in high or low temperature, use a wire or cable suitable for such temperature. Use cables and wires which meet atmospheric conditions. Take necessary measure to avoid corrosion or damage of cables and wires.

IMPORTANT

When mounting on a sensor head, do not overtighten the screws.

■ Wiring Diagram

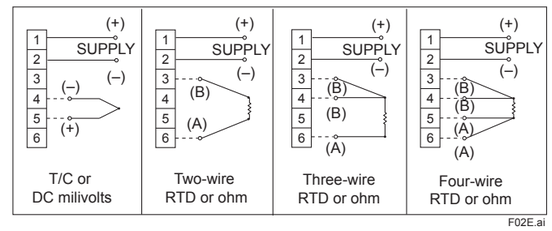

F02E.ai

■ Dimensions

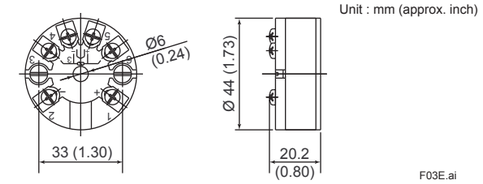

F03E.ai

7. Approvals Options

7.1 CENELEC ATEX (KEMA) Intrinsically safe model (/KS2, /DS2, /SS2)

ATEX Certificate: KEMA 10 ATEX0027
Applicable Standard: EN 60079-0: 2006, EN 60079-11: 2007, EN 60079-26: 2007, EN 61241-0: 2006, EN 61241-11: 2006

[Installation diagram]

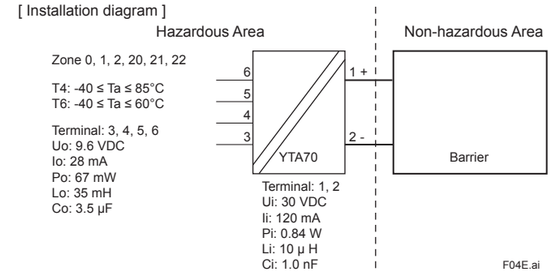

F04E.ai

Maximum Ambient Temperature for gas-proof
For T4: 85°C, For T6: 60°C
Maximum Surface Temperature for dust-proof
For T4: T105°C (Ambient Temperature: –40 to 85°C)
For T6: T85°C (Ambient Temperature: –40 to 60°C)

7.2 FM Intrinsically safe/Nonincendive model (/DS2, /SS2)

Applicable Standard: FM 3600, FM 3610, FM 3611, FM 3810
Installation diagram

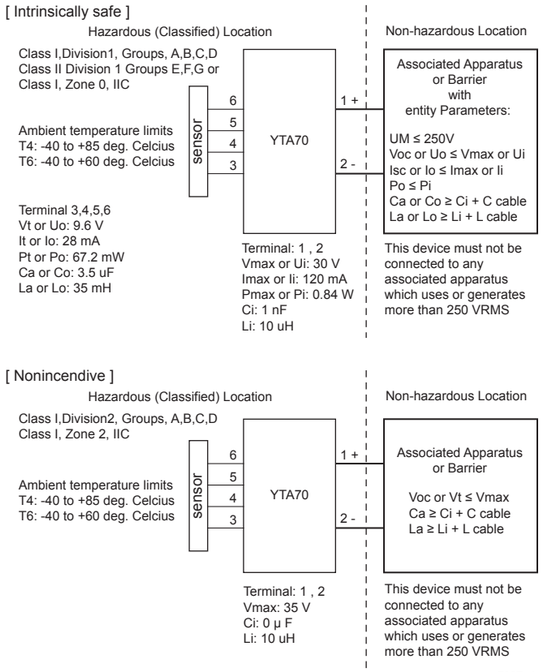

F05E.ai

7.3 IECEx Scheme Intrinsically safe model (/SS2)

Certificate No.: IECEx KEM 10.0086
Applicable Standard: IEC 60079-0:2007-10, IEC 60079-11:2006,
IEC 60079-26:2006, IEC 61241-11:2005

[Installation diagram]

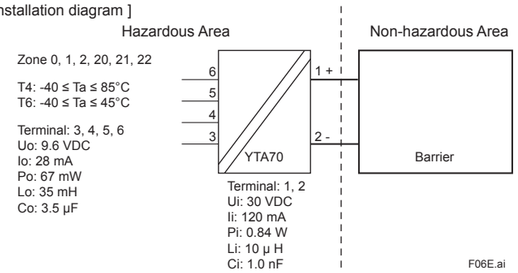

F06E.ai

8. HART Communication

8.1 Connection and Requirements

A standard HART communicator can be used for programming the YTA70. The HART communicator must be loaded with the appropriate DDL driver for YTA70.

Minimum loop resistance is 250Ω. If the receiving equipment has a lower resistance, a serial resistor must be inserted to communicate with the HART communicator.

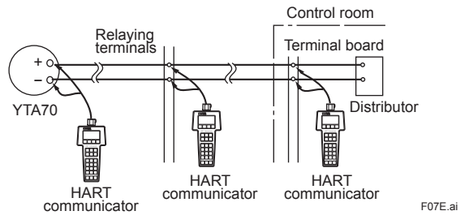

F07E.ai

Connection

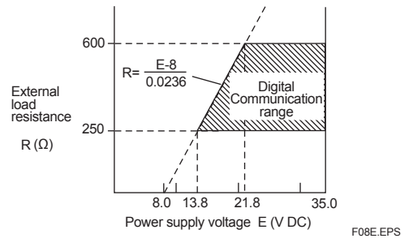

F08E.EPS

Communication requirement

8.2 Parameters

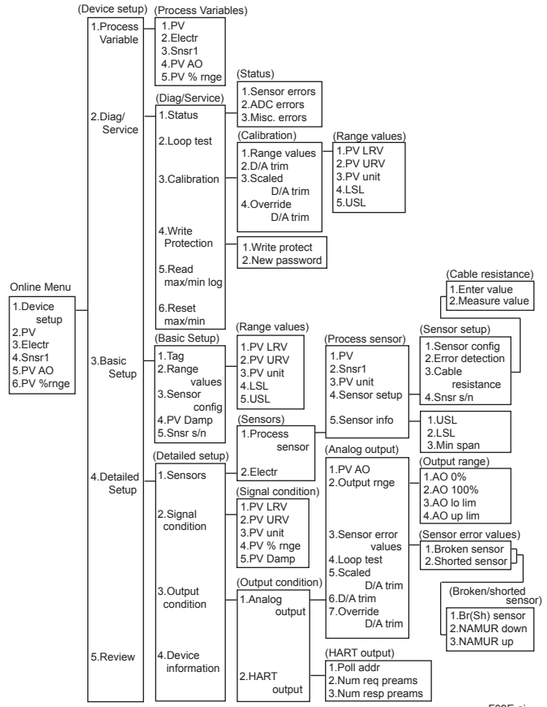

F09E.ai

Parameters List

Item		HART Communicator	Selection/Setting Range	Initial Setting
Process Variable	Process Variable	PV	Measured variables in engineering unit.	—
		Electr	Terminal temperature	—
	Output value	PV AO	Output value in mA	—
		PV % rnge	Output value with respect to the range in %	—
	PV Log	Read max/min log	Reads the maximum/minimum PV stored in the memory	—
		Reset max/min	Clears the PV maximum/minimum log and restart logging	—
Signal Condition	Range value	PV LRV/PV URV	Lower/upper range value to defines the 0%/100% value of the measurement	LRV: 0 URV:100 *1
	Range Limit	LSL/USL	Shows the max./min. usable value for upper/lower range value	—
	Unit	PV unit	Engineering unit to be displayed with such digital value as PV, URV, LRV, USL, LSL,min.span, etc.	°C
	Damping	PV Damp	Damping time constant in seconds applied to the digital value. 0 to 62.5(s)	0.43(s) *1
Sensor Setup	Sensor config	Sensor type (wire, unit)	Sensor type and related settings. [When T/C or milivolts is selected] Always select “single” for a measurement type. [When RTD or ohm is selected] Always select 2-, 3- or 4-wire but others for the number of sensor wires.	Pt100 3-wire °C *1
		RTD factor	For RTD only. Leave it to “1.”	1
		Cold Junction Compensation	For T/C only. Always leave it to “1.internal sensor.”	Internal sensor
	Sensor Errors	Error detection	Type of sensor errors to be detected for burnout operation. (1)No test performed, (2)broken sensor, (3)shorted sensor*3, or (4)broken & shorted*3	broken sensor
	Cable resistance	Enter value	Enter new value of the RTD/ohm cable resistance for compensation.	5 (ohm)
		Measure value	Actually measure the cable resistance of 2-wire RTD/ohm for compensation.	—
	Minimum span limit	Min.span	Minimum settable span	—
Output Condition	Analog Output range	AO 0%(100%)	Output value for 0%(100%) in mA.	4(0%) 20(100%)
		AO lo(up) lim	Output lower(upper) limit in mA. NAMUR, or 3.8 to 23mA	NAMUR
		Sensor Error values	Enter or select the output value when sensor error is detected. NAMUR upscale, NAMUR downscale, or value within 3.5 to 23mA	NAMUR upscale [high] *1
		Loop test	Change the output manually for testing the loop. 4mA, 20mA, or value within 3.5 to 23mA	—
Diagnostics	Error status	Sensor errors	Show error status related to a sensor. When any one of the errors turns "ON", check the sensor and wiring.	—
		ADC errors	Show error status related to analog to digital conversion. When any one of the errors turns "ON", Repower the device. If error remains, replace the device.	—
		Misc. errors	Show error status related to a device. When any one of the errors turns "ON", Re-power the device. If error remains, replace the device.	—
Calibration	Write protection	Write protect	Write-protects the device, if correct password is entered. *2	Not protected
		New password	Sets a new password for wirte protection, if correct password is entered.	—
	Apply trim	D/A trim	Allows the calibration of a selected analog output with an external reference at the operating endpoint.	—
		Scaled D/A trim	Allows the calibration of the analog output with the external reference which is scaled at 0 to 100%.	—
	Clear trim	Override D/A trim	Overrides any previous D/A trimming by restoring factory calibration values.	—
Device information		Manufacturer	Manufacturer identification code	Yokogawa
		Model	Model name	YTA70-E
		TAG	Tag number, up to 8 alphanumerical characters.	—
		Descriptor	Text which can be used by user in any way. Up to 16 alpha-numerical characters	—
		Message	Text which can be used by user in any way. Up to 32 alpha-numerical characters	—
		Date	Date information. MM/DD/YY. Not inclemented. The date is updated whenever changing configuration via PC configurator.	Factory calibration date
		Write protect	Indicates whether the device is write-proteced.	Not protected
		Snsr s/n	Not used.	0
		Final assembly number	Not used.	0
		Distributor	—	Yokogawa
		Revision #'s	Software/hardware revision number	—
		Status	Error stauts (see “Error status” in this table.)	—
Review	Input info		List of input variables	—
	Output info		List of output variables	—
	Device information		See “Device information” in this table.	—

*1: Or as specified upon ordering.
*2: The initial setting of password upon shipment is "********".
*3: With T/C or milivolts for sensor type, the alarm is generated when the input signal drops down below 2.5 mV.

◆ Revision Record

- **Manual No. : IM 01C50C03-01EN**
- **Title : YTA70 Temperature Transmitter**

Edition	Date	Page	Revised item
1st	Mar. 1999	—	New Publication.
2nd	June 1999	1 6 10	Add code "/DS1" in the table Add "7.2 FM intrinsically safe model" Add "note 2" .
3rd	Feb. 2000	2,3 4 9 11	Revise accuracy & temperature effect. Correct "Isolation". Add explanation Add "Note".
4th	Mar. 2002	1 2	Change Optional code KS1 and DS1 to KS2 and DS2 respectively. Add description(4) based on ATEX directives.
5th	July 2003	1,5,6	Delete code "/KS1" and "/DS1".
6th	Feb. 2007	2,3,6	Add handling precaution. Change specifications of FM Intrinsically safe model.
7th	July 2011		Change marking for KS2 and DS2. Change Certificate number and applicable standard. Change electrical data. Add 7.3 IECEx scheme approval.